


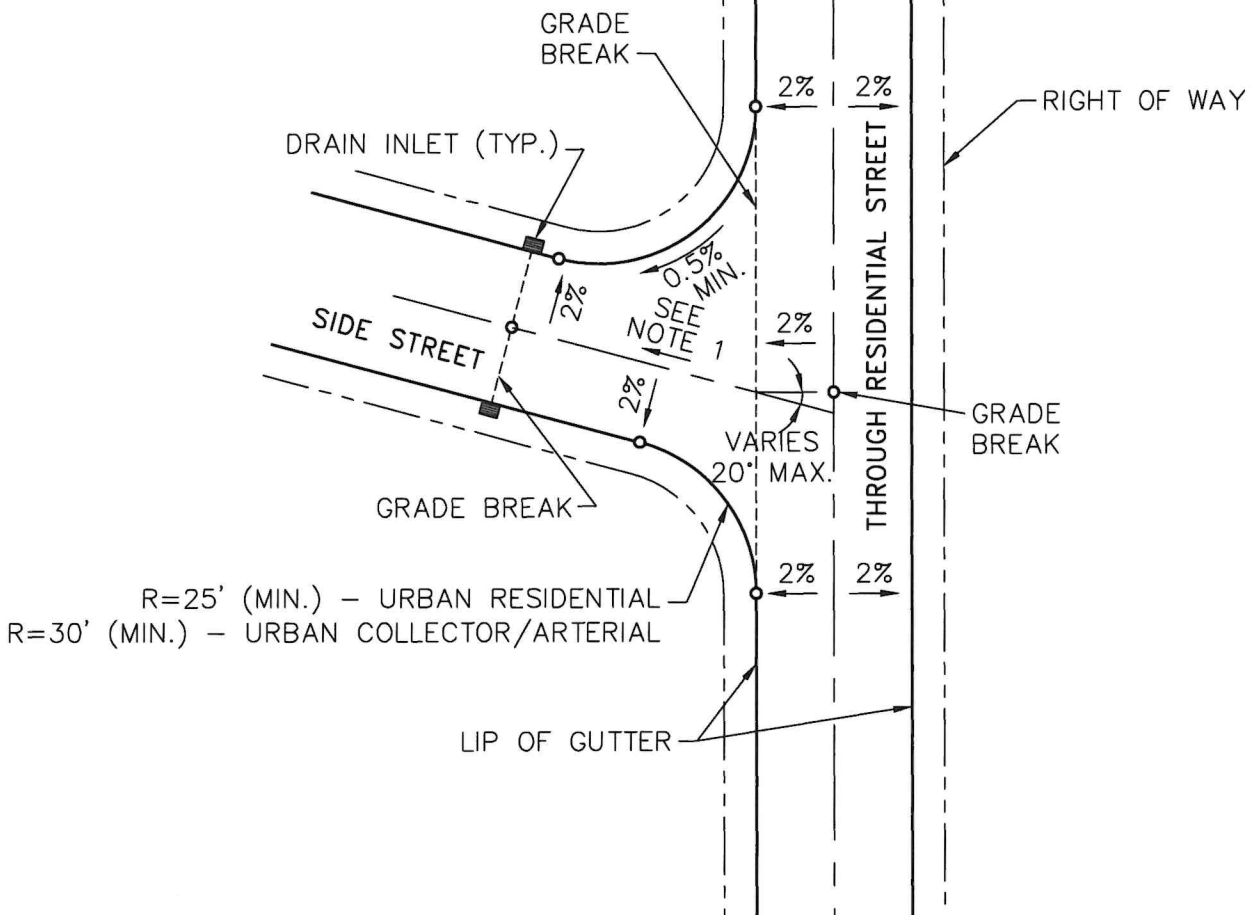

NOTES:

1. SET PROFILE GRADE SO THAT MINIMUM SLOPE ON ALL GUTTER GRADES WILL BE 0.50% THROUGH CURB RETURN.
2. INTERSECTION ANGLE BETWEEN SIDE STREETS WITH AN URBAN COLLECTOR OR ARTERIAL SHALL BE 90°.
3. THE CONTRACTOR SHALL VERIFY AND ENSURE THAT PAVEMENT AT ALL CROSSWALK CROSSINGS COMPLIES WITH ADA ACCESSIBILITY REQUIREMENTS. THE FINISHED SURFACE SHALL NOT EXCEED A 2% CROSS SLOPE AND SHALL MAINTAIN A MAXIMUM 5% RUNNING SLOPE (PATH OF TRAVEL).
4. A WATER FLOW TEST SHALL BE PERFORMED IN THE COMPLETED CURB AND GUTTER SYSTEM TO VERIFY POSITIVE DRAINAGE AND PROPER FLOW PER PUBLIC WORKS.

YUBA COUNTY
DEPARTMENT OF PUBLIC WORKS

URBAN RESIDENTIAL INTERSECTIONS

APPROVED BY: *[Signature]*

DATE: 8/12/20

105