


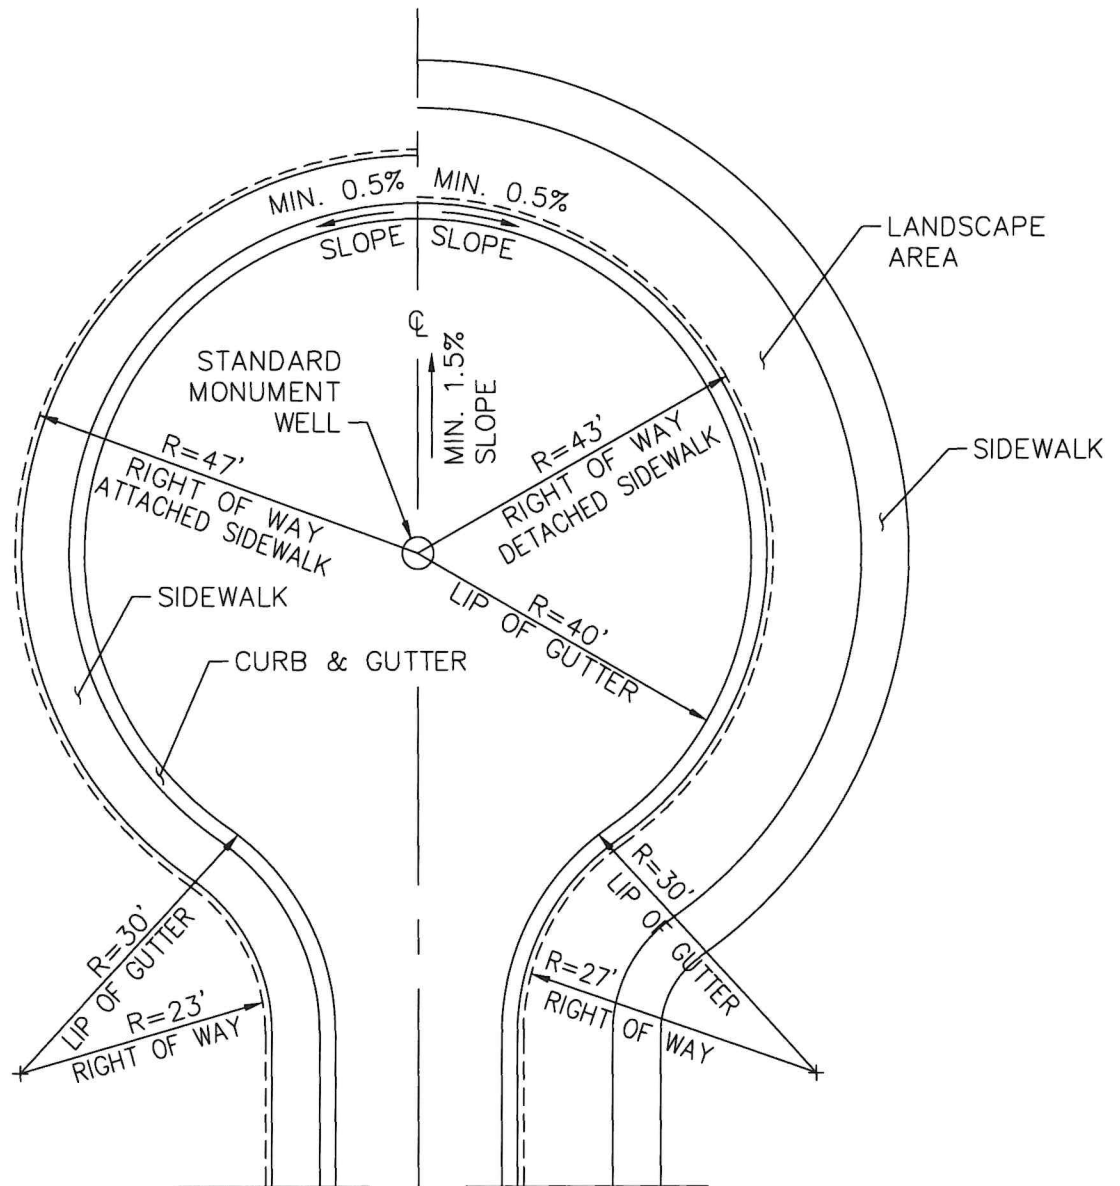

NOTES:

1. STRUCTURAL SECTION IN CUL-DE-SAC SHALL MATCH URBAN RESIDENTIAL (LOCAL) ROAD.
2. PROPOSED FLOWLINE OR EDGE OF PAVEMENT ELEVATIONS SHALL BE INDICATED AT 25 FOOT (MAXIMUM) INTERVALS.
3. A WATER FLOW TEST SHALL BE PERFORMED IN THE COMPLETED CURB AND GUTTER SYSTEM TO VERIFY POSITIVE DRAINAGE AND PROPER FLOW PER PUBLIC WORKS.

YUBA COUNTY
DEPARTMENT OF PUBLIC WORKS

TYPICAL URBAN
CUL-DE-SAC

APPROVED BY:

8/12/26
DATE:

106