


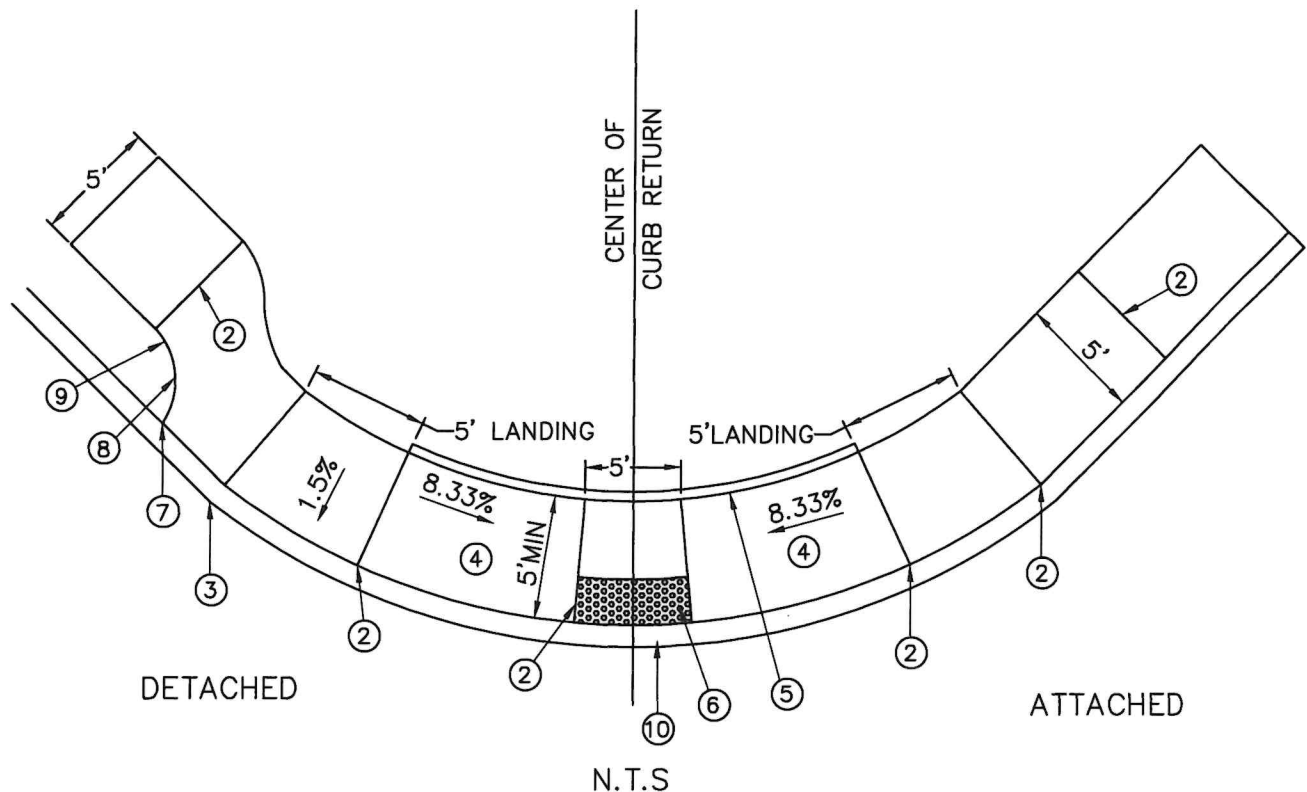

NOTES:

1. ALL LANDINGS ARE 5' MIN. AND SIDEWALK WIDTH 5' MIN
2. CONCRETE JOINT & FINISH DETAIL PER DETAIL 208
3. CURB AND GUTTER PER DETAIL 201
4. THE MAXIMUM IS 8.33% FOR "CASE C" RAMPS, ON STEEPER GRADES WHERE 8.33% CANNOT BE ACHIEVED, 25 FEET IS THE MAXIMUM LENGTH TRANSITION REQUIRED
5. 6 INCH WIDE RETAINING CURB, HEIGHT TO BE DETERMINED BY PROJECTED BACK OF WALK GRADE. POUR MONOLITHIC WITH SIDEWALK
6. DETECTABLE WARNING PANEL, TRUNCATED DOMES. 1% TO 2% GRADE TO FLOW LINE
7. TERMINATE PLANTER RADIUS AT CURB RETURN. RADIUS SHALL MATCH PLANTER WIDTH.
8. RADIUS PLANTER WIDTH VARIES
9. SIDEWALK AND RAMP SECTIONS PER DETAIL 202
10. GUTTER PAN SLOPE NOT TO EXCEED 5% MAX. IN PATH OF TRAVEL
11. LOCATE RAMP AT MIDPOINT OF CURB RETURNS.
12. SIDEWALK AND RAMP SHALL BE CONSTRUCTED WITH 6 SACK, 4000 PSI MIN. CONCRETE IN ACCORDANCE WITH CALTRANS STANDARD SPECIFICATIONS.
13. NO PULL BOX, UTILITY VAULT, UTILITY POLE, MANHOLE OR OTHER OBSTRUCTIONS SHALL BE LOCATED WITHIN SIDEWALK OR RAMP AREA.
14. ALL INLETS SHALL BE LOCATED OUTSIDE OF CURB RETURNS.
15. CONTRACTOR TO PROVIDE ADEQUATE JOINTS TO CONTROL CRACKING.
16. MEET CURRENT ADA STANDARDS. INSTALL RAISED TRUNCATED DOMES AS REQUIRED.
17. DOWEL RAMP ONLY INTO CURB/GUTTER WITH #4 REBAR 18" O.C.
18. ALL RAMPS TO BE INCLUDED IN SOIL STABILIZATION PER PLAN REQUIREMENT
19. 'WET SET' ONLY TO MATCH DETAIL 203A.
20. OPTION TO POUR RAMP MONOLITHICALLY.

YUBA COUNTY
DEPARTMENT OF PUBLIC WORKS

CASE "C" PEDESTRIAN CURB
RAMP AT CURB RETURN

[Signature]
APPROVED BY:

8/14/06
DATE:

203