


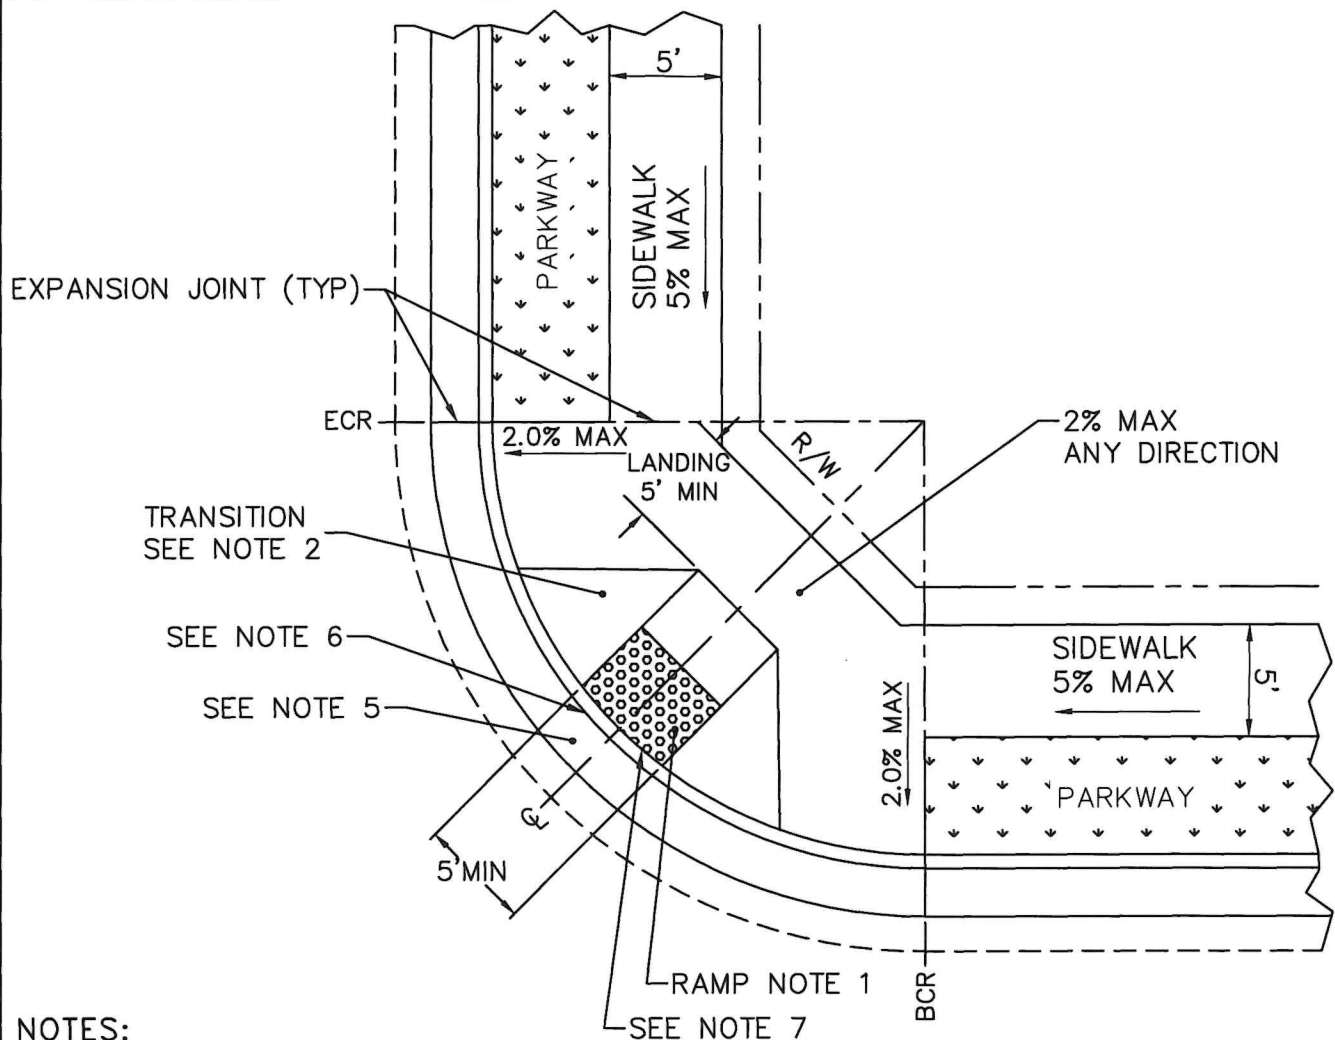

NOTES:

1. RAMP SLOPE 8.33% MAXIMUM.
2. TRANSITION SLOPE 8.33% MAXIMUM.
3. CENTER RAMP ON MIDPOINT OF CURB RETURN.
4. THE CONCRETE FINISH OF THE RAMP SHALL HAVE A BROOMED SURFACE TEXTURE PER DETAIL 208.
5. THE GUTTER PAN ACROSS THE ROUTE OF TRAVEL, FROM THE RAMP TO THE STREET, SHALL HAVE A MAXIMUM SLOPE OF 5%.
6. DETECTABLE WARNING SURFACE TO BE INSTALLED 6" TO 8" FROM GUTTER FLOWLINE AND EXTEND 36 INCHES MINIMUM IN THE DIRECTION OF TRAVEL AND THE FULL WIDTH OF THE CURB RAMP.
7. ALL CONCRETE TO BE 6 SACK, 4000 PSI MIN. DOWEL ADA RAMP TO CURB
8. LANDING TO BE 5' MINIMUM WITH 2% MAX SLOPE IN ANY DIRECTION
9. NO PULL BOX, UTILITY VAULT POLE, MANHOLE OR OTHER OBSTRUCTIONS SHALL BE LOCATED WITHIN SIDEWALK OR RAMP AREA.

YUBA COUNTY
DEPARTMENT OF PUBLIC WORKS

PLAZA RAMP

Bin
APPROVED BY:

8/14/20
DATE:

204