


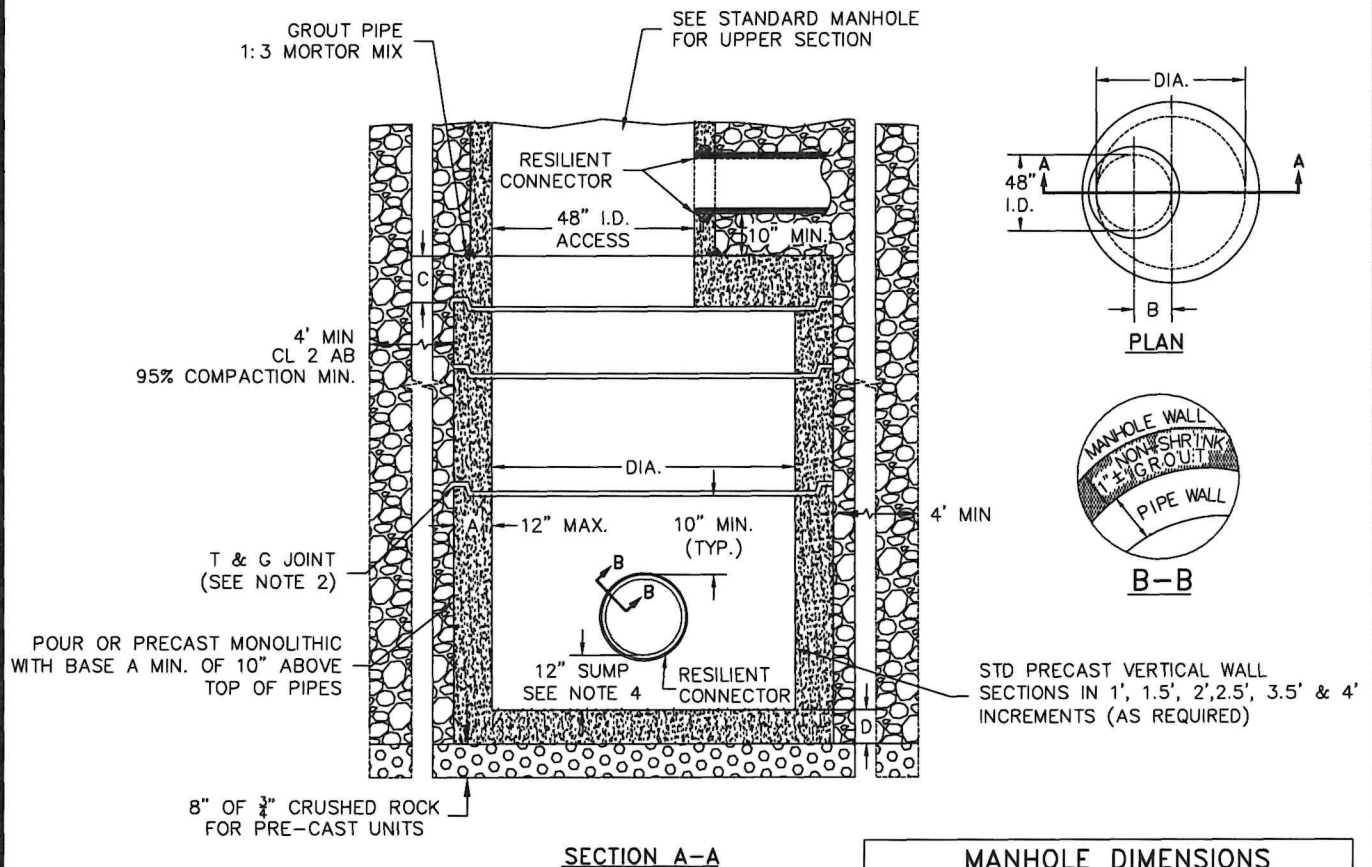

MANHOLE DIMENSIONS				
DIA.	A	B	C	D
72"	7"	12"	10"	8"
84"	8"	18"	10"	10"
96"	9"	24"	10"	12"

NOTES:

1. PRECAST MANHOLES TO BE MANUFACTURED TO ASTM SPECIFICATION C478 AND MEET H-20 LOADING REQUIREMENTS. CAST-IN-PLACE TO BE 6 SACK CONCRETE WITH 4,000 PSI MIN.
2. ALL JOINTS SHALL BE MADE WITH PREFORMED PLASTIC JOINT SEALING COMPOUND. FOLLOWING INSTALLATION GROUT ALL INTERIOR AND EXTERIOR JOINTS WITH 1:3 MORTAR MIX.
3. CENTRAL PRECAST MODELS 20-72, 84, 96 ERS OR APPROVED EQUAL.
4. SUMP IS NOT REQUIRED ON MANHOLES CONNECTING PIPES 24" DIAMETER OR LARGER IF NO DI LATERALS ARE PRESENT.
5. PRECAST MANHOLES SHALL BE SIZED TO PROVIDE THE FOLLOWING: THE CLEAR SPACE ON THE INSIDE OF THE MANHOLE BARREL BETWEEN CORED PIPE CONNECTION HOLES SHALL BE A MINIMUM OF 10". IF THE CONNECTION HOLE IS CAST MONOLITHICALLY WITH THE MANHOLE BARREL, THE MEASUREMENT SHALL BE TAKEN FROM THE FINISHED CONCRETE CONNECTION SURFACE.
6. MINIMUM 10" CLEARANCE BETWEEN ALL PIPES AND BETWEEN PIPES AND JOINTS.
7. THE STORM DRAIN SYSTEM SHALL HAVE WATERTIGHT JOINTS AT ALL CONNECTIONS.
8. NO PIPE SHALL BE CONNECTED IN THE JOINTS OF MANHOLE.
9. THE MANHOLE ACCESS SHALL BE AT THE UPSTREAM SIDE OF MAINLINE.
10. SUBGRADE TO BE APPROVED BY ENGINEER OR GEOTECH PRIOR TO PLACEMENT OF CRUSHED ROCKS.

YUBA COUNTY
DEPARTMENT OF PUBLIC WORKS

LARGE MANHOLE ASSEMBLY

APPROVED BY: *[Signature]*

DATE: *8/1/96*

405